




NOTE: IN PEDESTRIAN CIRCULATION AREA, MAXIMUM 4 IN. PROJECTION FOR POST OR WALL MOUNTED OBJECTS BETWEEN 27 IN. AND 80 IN. ABOVE THE SURFACE.

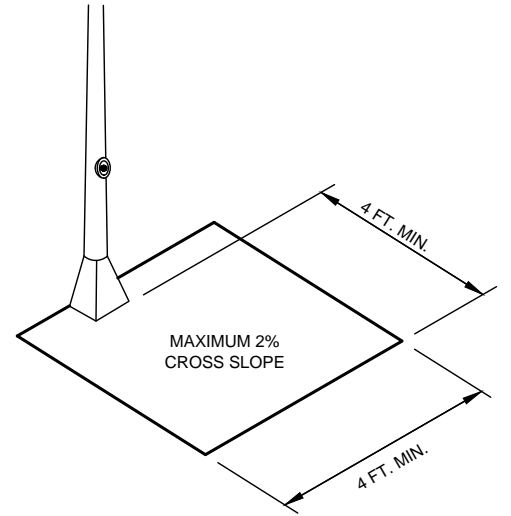

CLEAR SPACE ADJACENT TO PEDESTRIAN PUSH BUTTON

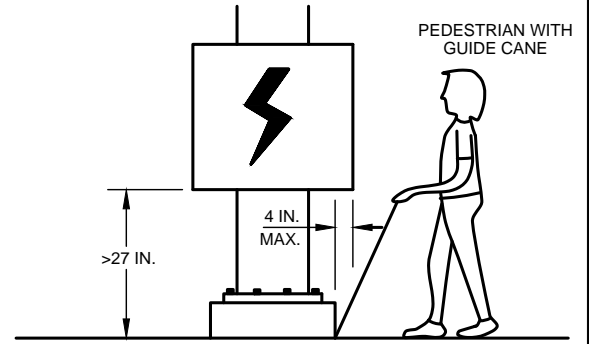


WHEN AN OBSTRUCTION OF A HEIGHT GREATER THAN 27 IN. FROM THE SURFACE WOULD CREATE A PROTRUSION OF MORE THAN 4 IN. INTO THE PEDESTRIAN CIRCULATION AREA, CONSTRUCT ADDITIONAL CURB OR FOUNDATION AT THE BOTTOM TO PROVIDE A MAXIMUM 4 IN. OVERHANG.

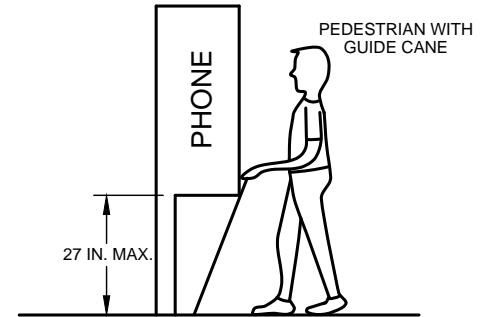

PROTRUDING OBJECTS OF A HEIGHT 27 IN. ARE DETECTABLE BY CANE AND DO NOT REQUIRE ADDITIONAL TREATMENT.

DETECTION BARRIER FOR VERTICAL CLEARANCE < 80 IN.

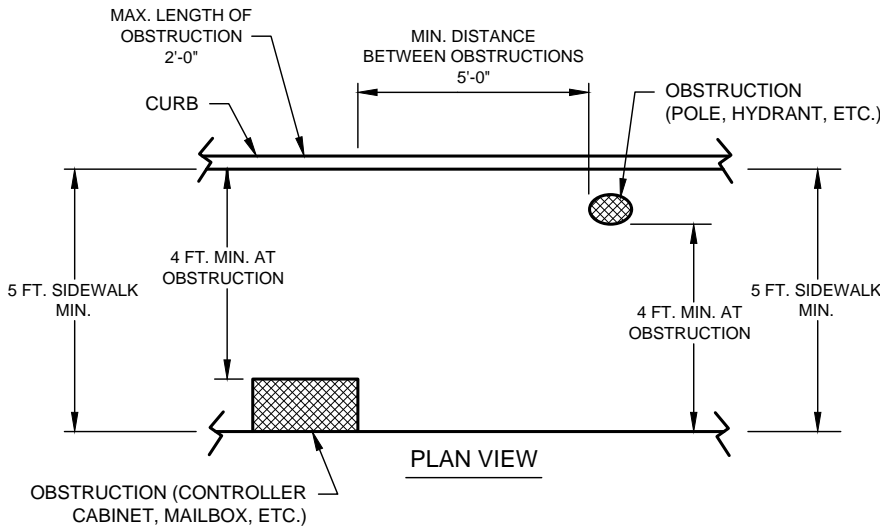

PLACEMENT OF STREET FIXTURES

NOTE: ITEMS NOT INTENDED FOR PUBLIC USE. MINIMUM 4 FT. X 4 FT. CLEAR GROUND SPACE REQUIRED AT PUBLIC USE FIXTURES.

VERTICAL AND HORIZONTAL CLEARANCE REQUIREMENTS

(NO SCALE)

SEE SHEETS SW-5 AND SW-6 FOR GENERAL NOTES AND LEGEND

DISCLAIMER: THE USE OF THIS STANDARD IS GOVERNED BY THE "TEXAS ENGINEERING PRACTICE ACT". NO WARRANTY OF ANY KIND IS MADE BY THE CITY OF WACO FOR ANY PURPOSE WHATSOEVER. THE CITY OF WACO ASSUMES NO RESPONSIBILITY FOR THE CONVERSION OF THIS STANDARD TO OTHER FORMATS OR FOR INCORRECT RESULTS OR DAMAGES RESULTING FROM ITS USE.



ENGINEERING DIVISION



REVISIONS			
NO.	COMMENTS	BY	DATE
##	DESCRIPTION	FL	MM/DD/YYYY

DATE
01/10/2022

SW-10