


LIP OF GUTTER SHALL BE SAME ELEVATION AS TOP OF SURFACE COURSE. IF BOTTOM OF CURB DOESN'T EXTEND TO TOP OF SUBGRADE FILL MUST BE ONE OF THE FOLLOWING:

- ① CONCRETE (EXTEND DEPTH OF CURB)
- ② 4" MINIMUM COMPACTED ROAD GRAVEL
- ③ 4" MINIMUM COMPACTED STABILIZED SUBGRADE MATERIAL

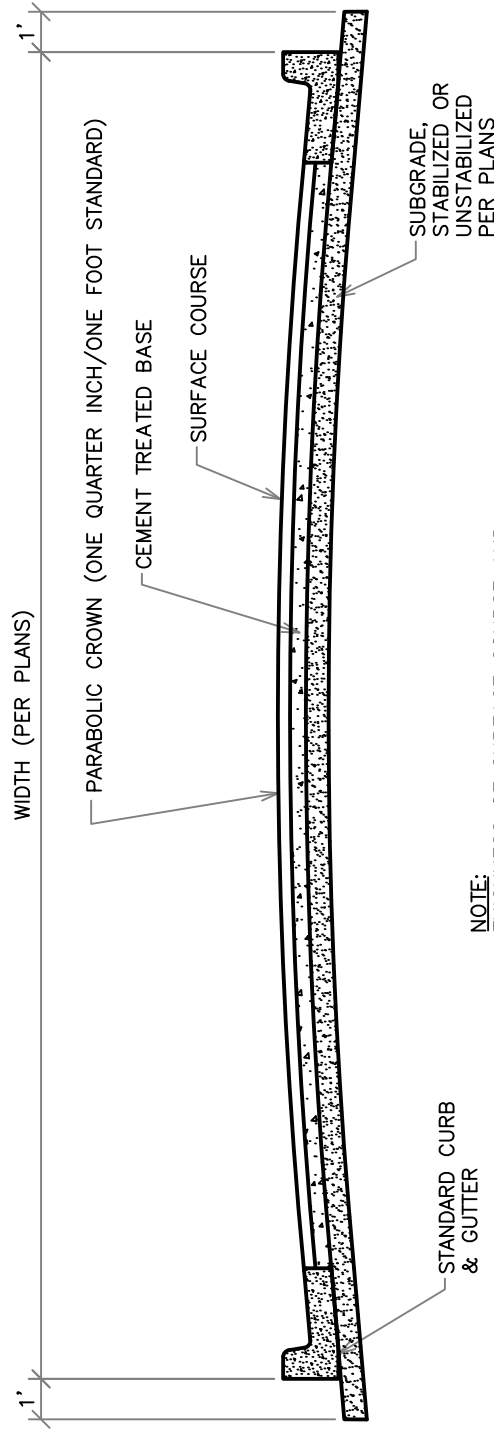

NOTE:
 THICKNESS OF SURFACE COURSE AND CEMENT TREATED BASE ARE AS PER PLANS IF PI OF SUBGRADE IS MORE THAN 15. THE SUBGRADE MUST BE STABILIZED. STABILIZATION AGENT AND AMOUNT SHALL BE DETERMINED BY GEOTECHNICAL TESTING AND SHALL BE SPECIFIED ON PLANS.

STREET SECTION

DISCLAIMER: THE USE OF THIS STANDARD IS GOVERNED BY THE "TEXAS ENGINEERING PRACTICE ACT". NO WARRANTY OF ANY KIND IS MADE BY THE CITY OF WACO FOR ANY PURPOSE WHATSOEVER. THE CITY OF WACO ASSUMES NO RESPONSIBILITY FOR THE CONVERSION OF THIS STANDARD TO OTHER FORMATS OR FOR INCORRECT RESULTS OR DAMAGES RESULTING FROM ITS USE.



**ENGINEERING
SERVICES**



REVISIONS				DATE
NO.	COMMENTS	BY	DATE	
03	ADD DISCLAIMER	MZ	01/10/2022	01/10/2022
02	REMOVE SEAL	DG	09/03/2014	
01	UPDATED	DG	10/01/2010	