


**DIRECT FLOW**

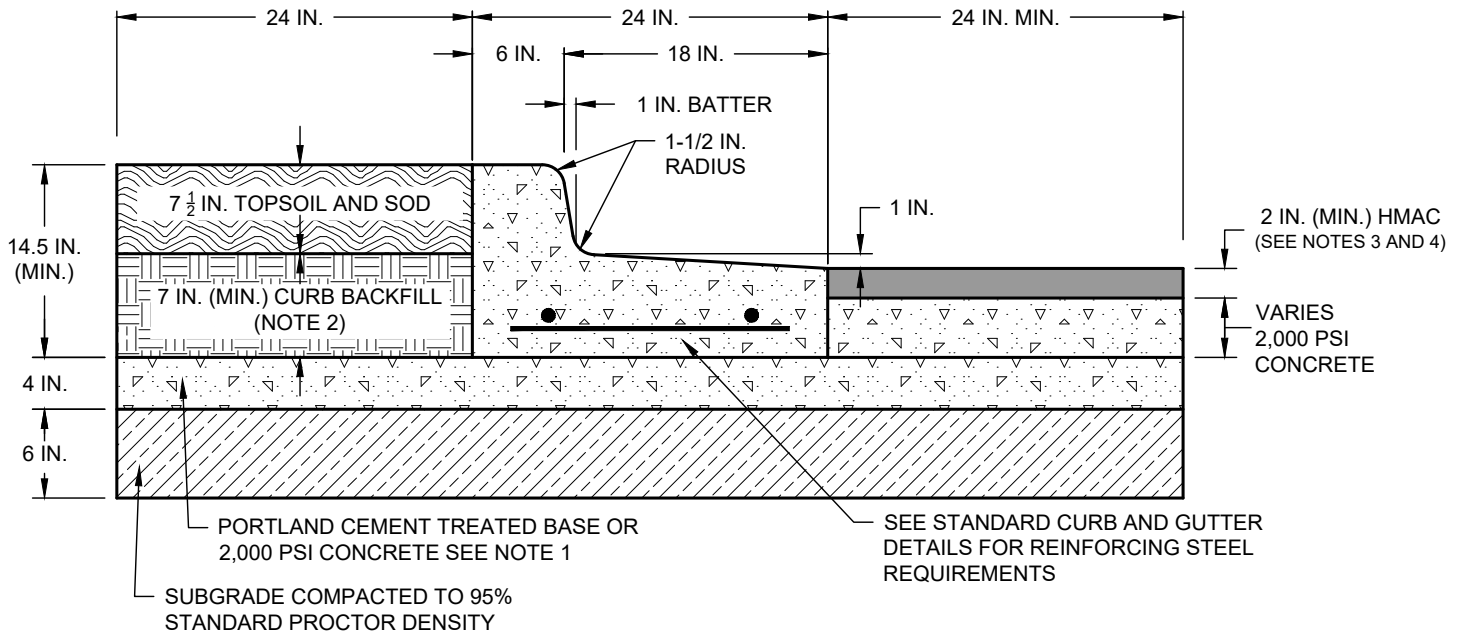

**INDIRECT FLOW**

**NOTES:**

1. CURB AND GUTTER SHALL BE PLACED SEPARATELY AFTER BASE OR 2,000 PSI CONCRETE HAS CURED.
2. TYPE "A" MATERIAL PER STANDARD SPECIFICATIONS FOR CONSTRUCTION SECTION 4.2 EXCAVATION AND BACKFILL PART 2: PRODUCT A. MATERIALS 3. TRENCH BACKFILL A. TYPE "A" MATERIAL MECHANICALLY COMPACTED TO 95% OF THE MAXIMUM DRY DENSITY (TEX-113-E).
3. HMAC SHALL BE TYPE D FOR STREET CLASSIFICATION LOCAL AND RESIDENTIAL COLLECTOR.
4. HMAC SHALL BE TYPE C OR TYPE D FOR STREET CLASSIFICATION OF COMMERCIAL COLLECTOR AND INDUSTRIAL COLLECTOR. FOR INDUSTRIAL COLLECTOR DEPTH OF HMAC SHALL BE 3 INCHES.

**STANDARD CURB & GUTTER REPLACEMENT DETAILS**

(USE FOR EXISTING STREETS ONLY)  
(NO SCALE)

DISCLAIMER: THE USE OF THIS STANDARD IS GOVERNED BY THE "TEXAS ENGINEERING PRACTICE ACT". NO WARRANTY OF ANY KIND IS MADE BY THE CITY OF WACO FOR ANY PURPOSE WHATSOEVER. THE CITY OF WACO ASSUMES NO RESPONSIBILITY FOR THE CONVERSION OF THIS STANDARD TO OTHER FORMATS OR FOR INCORRECT RESULTS OR DAMAGES RESULTING FROM ITS USE.



**ENGINEERING  
DIVISION**



REVISIONS			
NO.	COMMENTS	BY	DATE
##	DESCRIPTION	FL	MM/DD/YYYY

DATE  
11/29/2021

**ST-20**