


PLAN VIEW

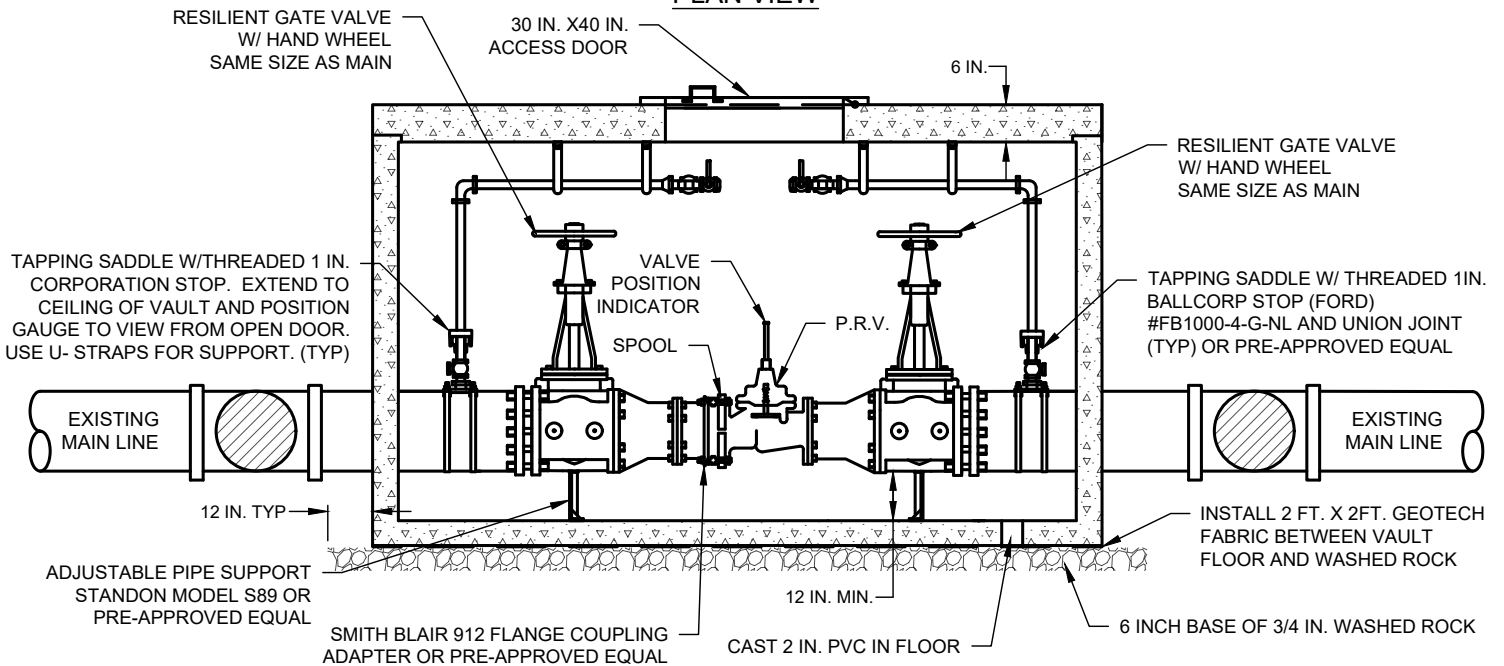

SECTION VIEW

NOTES:

1. ASSEMBLIES 2 IN. AND SMALLER SHALL HAVE AT LEAST A 6 IN. CLEARANCE ON BOTH DRAIN SIDES AND ON TOP OF THE ASSEMBLY, AND 12 IN. BELOW AND BEHIND THE ASSEMBLY. ALL ASSEMBLIES LARGER THAN 2 IN. SHALL HAVE A MINIMUM OF 12 IN. ON THE BACK SIDE, 24 IN. ON THE TEST COCK SIDE, AND THE RELIEF VALVE OPENING SHALL BE AT LEAST 12 IN. PLUS NOMIINAL SIZE OF ASSEMBLY ABOVE THE FLOOR OR HIGHEST POSSIBLE WATER LEVEL REMOVABLE TOP.
2. THE ASSEMBLY SHALL BE READILY ACCESSIBLE FOR TESTING AND MAINTENANCE, WITH A MINIMUM CLEARANCE OF 12 IN. ALL AROUND THE ASSEMBLY.

PRESSURE REDUCING VALVE ASSEMBLY ON NEW OR EXISTING MAIN

(NO SCALE)

SEE W-24B FOR ADDITIONAL NOTES

DISCLAIMER: THE USE OF THIS STANDARD IS GOVERNED BY THE "TEXAS ENGINEERING PRACTICE ACT". NO WARRANTY OF ANY KIND IS MADE BY THE CITY OF WACO FOR ANY PURPOSE WHATSOEVER. THE CITY OF WACO ASSUMES NO RESPONSIBILITY FOR THE CONVERSION OF THIS STANDARD TO OTHER FORMATS OR FOR INCORRECT RESULTS OR DAMAGES RESULTING FROM ITS USE.



**ENGINEERING
DIVISION**



REVISIONS			
NO.	COMMENTS	BY	DATE
1	UPDATE REF TO STD DETAIL	MZ	01/25/2023
##	DESCRIPTION	FL	MM/DD/YYYY

DATE
8/25/2021

W-24A