


**PROFILE VIEW**

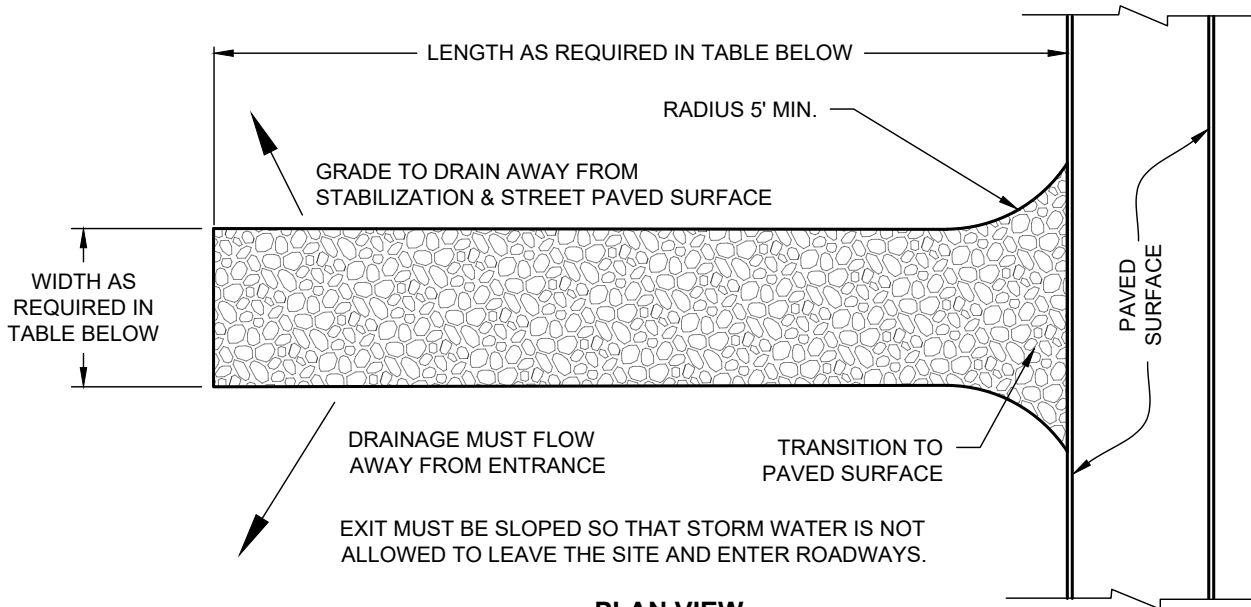

**PLAN VIEW**

TRACT AREA (A)	MINIMUM WIDTH OF EXIT	MINIMUM LENGTH OF EXIT
A<5 ACRE	20 FEET	50 FEET
A>5 ACRE	30 FEET	75 FEET

**NOTES:**

1. STABILIZED CONSTRUCTION EXITS SHALL BE USED FOR SITES IN WHICH SIGNIFICANT TRUCK TRAFFIC OCCURS ON A DAILY BASIS.
2. THE THICKNESS SHALL BE NO LESS THAN 12 INCHES.
3. STONE SHALL BE 3 TO 5 INCH DIAMETER COARSE AGGREGATE.
4. LENGTH SHALL BE SHOWN ON PLANS, MEETING TABLE REQUIREMENTS ABOVE.
5. WHEN NECESSARY, VEHICLES SHALL BE CLEANED TO REMOVE SEDIMENT PRIOR TO ENTRANCE ONTO PUBLIC ROADWAY. WHEN WASHING IS REQUIRED, IT SHALL BE DONE ON AN AREA STABILIZED WITH CRUSHED STONE WITH DRAINAGE FLOWING AWAY FROM BOTH THE STREET AND THE STABILIZED EXIT. ALL SEDIMENT SHALL BE PREVENTED FROM ENTERING ANY STORM DRAIN, DITCH, OR WATERCOURSE USING APPROVED METHODS.
6. THE EXIT SHALL BE MAINTAINED IN A CONDITION WHICH WILL PREVENT TRACKING OR FLOWING OF SEDIMENT ONTO PAVED SURFACES. THIS MAY REQUIRE PERIODIC TOP DRESSING WITH ADDITIONAL STONE AS CONDITIONS DEMAND. ALL SEDIMENT SPILLED, DROPPED, WASHED, OR TRACKED ONTO PAVED SURFACES MUST BE REMOVED IMMEDIATELY.
7. THE EXIT MUST BE PROPERLY GRADED OR INCORPORATE A DRAINAGE SWALE TO PREVENT RUNOFF FROM LEAVING THE CONSTRUCTION SITE.
8. INSPECTION SHALL BE SPECIFIED IN THE SWPPP.
9. PLEASE REFER TO THE CITY OF WACO STANDARD SPECIFICATIONS FOR CONSTRUCTION, SECTION 1.10, PART 2, A 8 AND PART 3, B 7 FOR CONSTRUCTION EXIT MATERIAL AND INSTALLATION SPECIFICATIONS.

**STABILIZED CONSTRUCTION EXIT**

(NO SCALE)

DISCLAIMER: THE USE OF THIS STANDARD IS GOVERNED BY THE "TEXAS ENGINEERING PRACTICE ACT". NO WARRANTY OF ANY KIND IS MADE BY THE CITY OF WACO FOR ANY PURPOSE WHATSOEVER. THE CITY OF WACO ASSUMES NO RESPONSIBILITY FOR THE CONVERSION OF THIS STANDARD TO OTHER FORMATS OR FOR INCORRECT RESULTS OR DAMAGES RESULTING FROM ITS USE.



**ENGINEERING  
DIVISION**



REVISIONS			
NO.	COMMENTS	BY	DATE
##	DESCRIPTION	FL	MM/DD/YYYY

DATE  
05/02/2022

**WP-5**