

WMARSS Central Plant Improvements




Central Plant Improvements

- Main Lift Station Improvements
- Sludge Processing Improvements
- Digester Improvements
- Disinfection Improvements
- Ventilation
- Bids
- Recommendation




CENTRAL WWTP IMPROVEMENTS

- Main Lift Station Improvements ▼
- Sludge Processing Building ▼
- Digester Improvements ▼
- Disinfection Improvements ▼

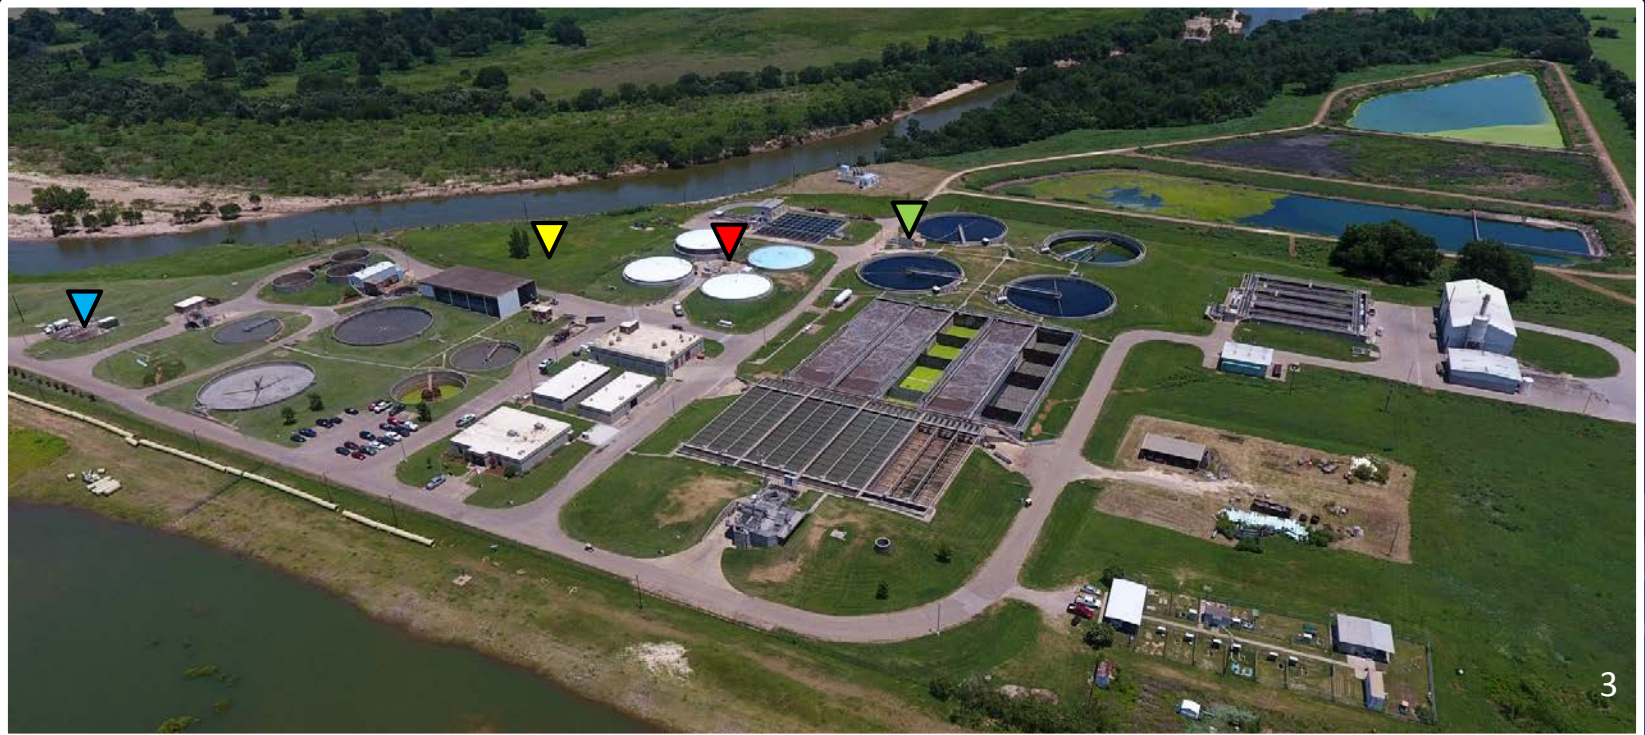

Main Lift Station Improvements

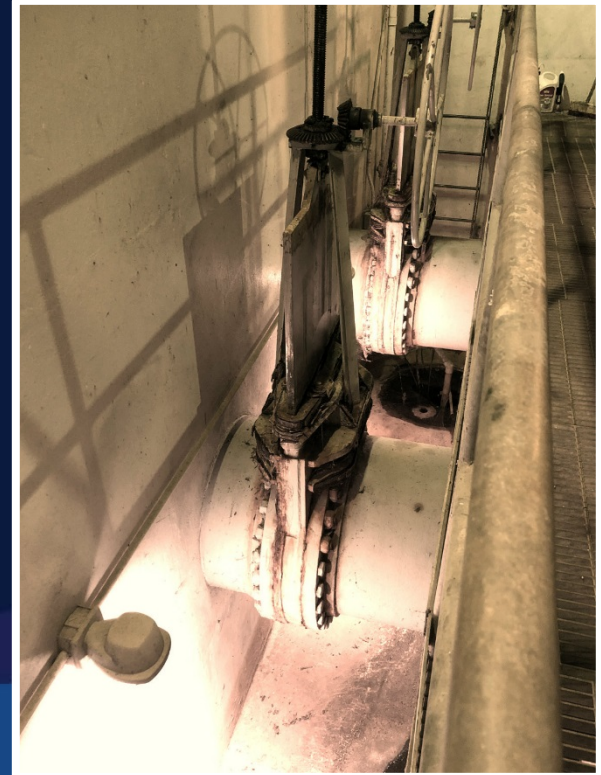

Sludge Processing Improvements



Digester Improvements



Disinfection Improvements



Ventilation

- Remove and replace ducts and fans for the generator and blower rooms
- Preparation for the electrical improvements CIP project



Bids

CENTRAL PLANT IMPROVEMENTS	
Bidder:	Bid Price:
Gracon Construction, Inc.	\$7,599,880.00
Archer Western Construction, LLC	\$8,027,400.00
CSA Construction, Inc.	\$8,589,600.00

VENTILATION IMPROVEMENTS	
Bidder:	Bid Price:
HCS, Inc. Commercial Contractor	\$257,204.00
R.E.C. Industries, Inc.	\$287,000.00

Recommendation

- Recommendation to award Central Plant Improvements at next council meeting
- City Staff recommends awarding the Ventilation Improvements contract to HCS, Inc. Commercial General Contractor, the lowest responsible bidder.

Questions?

