


DIRECT FLOW

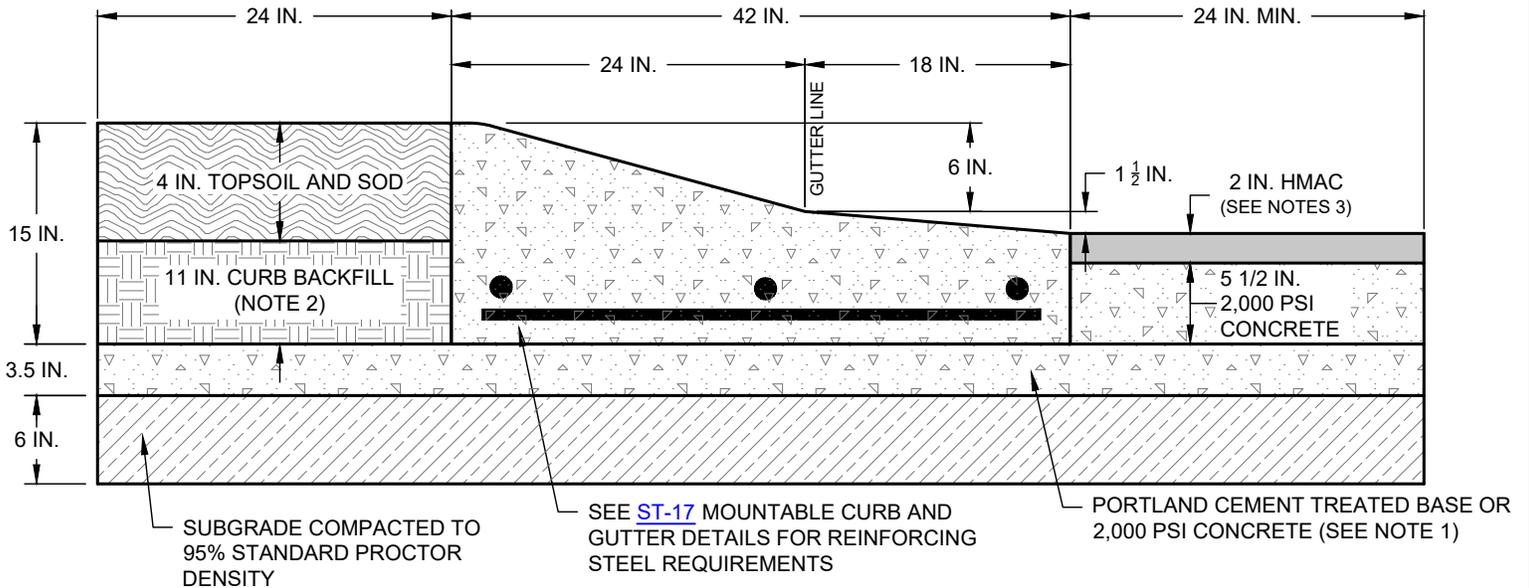

INDIRECT FLOW

NOTES:

1. CURB AND GUTTER SHALL BE PLACED SEPARATELY AFTER BASE OR 2,000 PSI CONCRETE HAS CURED.
2. TYPE "A" MATERIAL PER STANDARD SPECIFICATIONS FOR CONSTRUCTION SECTION 4.2 EXCAVATION AND BACKFILL PART 2: PRODUCT A. MATERIALS 3. TRENCH BACKFILL A. TYPE "A" MATERIAL.
3. PER [ST-17](#) NOTE 1 MOUNTABLE CURB AND GUTTER CAN ONLY BE USED FOR STREET FUNCTIONAL CLASSIFICATION OF LOCAL. HMAC SHALL BE TYPE D.
4. ORIGINAL PLACEMENT OF MOUNTABLE CURB & GUTTER AND REPLACEMENT OF MOUNTABLE CURB & GUTTER SHALL BE IN ACCORDANCE WITH THIS STANDARD DETAIL UNLESS SHOWN OTHERWISE IN PLANS APPROVED BY THE CITY.
5. MATERIALS SHALL BE COMPACTED IN ACCORDANCE WITH [G-1C](#).

MOUNTABLE CURB & GUTTER PLACEMENT AND REPLACEMENT DETAILS

(USE FOR EXISTING STREETS ONLY)
(NO SCALE)



ENGINEERING DIVISION

DISCLAIMER: THE USE OF THIS STANDARD IS GOVERNED BY THE "TEXAS ENGINEERING PRACTICE ACT". NO WARRANTY OF ANY KIND IS MADE BY THE CITY OF WACO FOR ANY PURPOSE WHATSOEVER. THE CITY OF WACO ASSUMES NO RESPONSIBILITY FOR THE CONVERSION OF THIS STANDARD TO OTHER FORMATS OR FOR INCORRECT RESULTS OR DAMAGES RESULTING FROM ITS USE.

REVISIONS			
NO.	COMMENTS	BY	DATE
1	MODIFY NOTES 2 & 3; MODIFY DIMS FOR TOPSOIL & BACKFILL; MOD. BASE DEPTH ON INDIRECT FLOW DETAIL	MZ	04/28/2025
##	DESCRIPTION	FL	MM/DD/YYYY

DATE
11/15/2024

ST-20C