


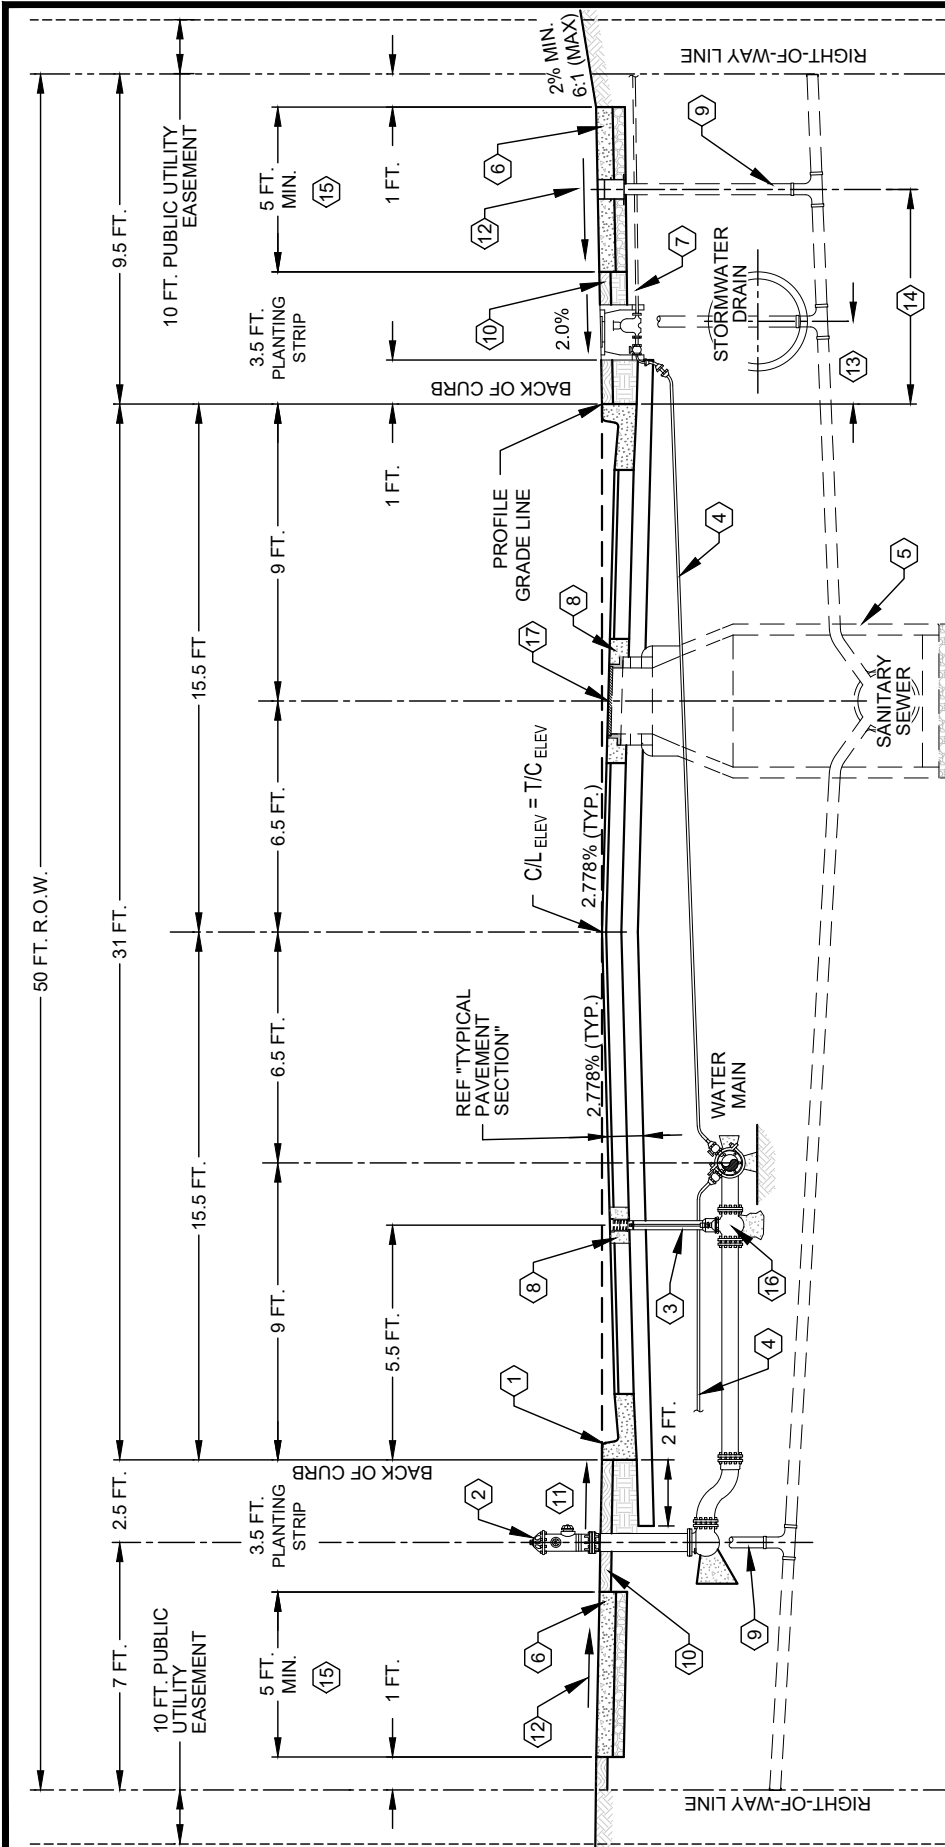

KEY NOTES:

- | | | |
|---------------------------------------|--|---|
| 1 STANDARD CURB & GUTTER | 7 YARD LINE | 13 WHEN NOT IN CONFLICT W/ STORMWATER DRAIN:
2.5 FT. TYPICAL |
| 2 FIRE HYDRANT CONNECTION PER W-2 | 8 CONCRETE PAD/DIAMOND | 14 WHEN IN CONFLICT W/ STORMWATER DRAIN:
6 FT. TYPICAL OR 18 IN. FROM O.D. OF STORMWATER DRAIN |
| 3 VALVE BOX & EXTENSION INSTALLATION | 9 SANITARY SEWER SERVICE W/ CLEANOUT BOX & COVER | 15 GREATER WIDTH MAY BE REQUIRED BY CODE OF ORDINANCES |
| 4 RESIDENTIAL WATER SERVICE | 10 4 IN. TOPSOIL W/ SOLID BLOCK SOD OR BERMUDA SEED W/ GREEN SOIL RETENTION BLANKET CLASS 1 TYPE A, B, C, OR D | 16 FIRE HYDRANT WATER VALVE CONNECTED TO WATER MAIN AS PER DETAIL W-2 |
| 5 PRECAST CONCRETE WASTEWATER MANHOLE | 11 SLOPE TOWARDS STREET: 1/4 IN. PER FT. TO 1/2 IN. PER FT. | 17 TOP OF RIM = TOC - 0.181 FT.
= TOC - 2 3/16 IN. |
| 6 REINFORCED CONCRETE SIDEWALK | 12 CROSS-SLOPE OF SIDEWALK SHALL BE 1.5% DESIGNED AND FORMED. ANY CROSS-SLOPE CONSTRUCTED LESS THAN 1% OR EXCEEDING 2% SHALL NOT BE ACCEPTED | |

LOCAL STREET AND RIGHT-OF-WAY CROSS-SECTION WITH UTILITY ASSIGNMENTS

(NO SCALE)

	ENGINEERING DIVISION		REVISIONS		DATE 04/28/2025	
			NO.	COMMENTS	BY	DATE
	DISCLAIMER: THE USE OF THIS STANDARD IS GOVERNED BY THE "TEXAS ENGINEERING PRACTICE ACT". NO WARRANTY OF ANY KIND IS MADE BY THE CITY OF WACO FOR ANY PURPOSE WHATSOEVER. THE CITY OF WACO ASSUMES NO RESPONSIBILITY FOR THE CONVERSION OF THIS STANDARD TO OTHER FORMATS OR FOR INCORRECT RESULTS OR DAMAGES RESULTING FROM ITS USE.		#	DESCRIPTION	FL	MM/DD/YYYY
			ST-2A			