




ENGINEERING DIVISION

DISCLAIMER: THE USE OF THIS STANDARD IS GOVERNED BY THE "TEXAS ENGINEERING PRACTICE ACT". NO WARRANTY OF ANY KIND IS MADE BY THE CITY OF WACO FOR ANY PURPOSE WHATSOEVER. THE CITY OF WACO ASSUMES NO RESPONSIBILITY FOR THE CONVERSION OF THIS STANDARD TO OTHER FORMATS OR FOR INCORRECT RESULTS OR DAMAGES RESULTING FROM ITS USE.

REVISIONS			
NO.	COMMENTS	BY	DATE
##	DESCRIPTION	FL	MM/DD/YYYY

DATE
04/28/2025

ST-2C

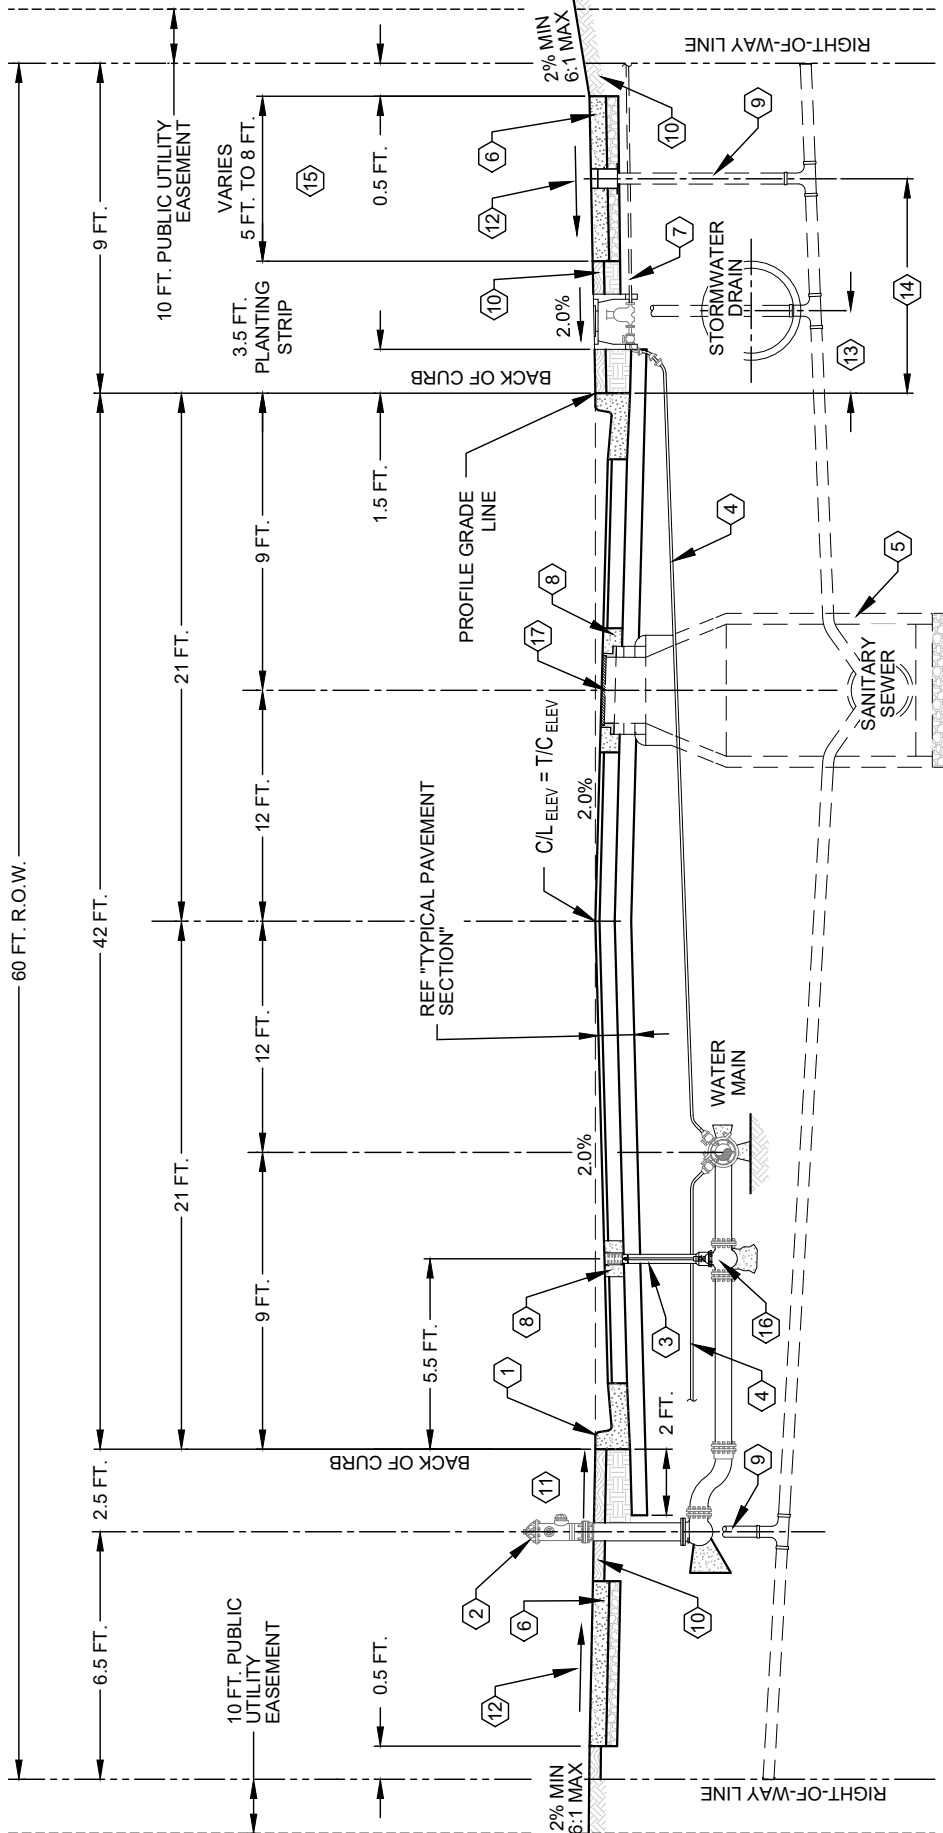

KEY NOTES:

- 1 STANDARD CURB & GUTTER
- 2 FIRE HYDRANT CONNECTION PER W-2
- 3 VALVE BOX & EXTENSION INSTALLATION
- 4 WATER SERVICE
- 5 PRECAST CONCRETE WASTEWATER MANHOLE
- 6 REINFORCED CONCRETE SIDEWALK
- 7 YARD LINE
- 8 CONCRETE PAD/DIAMOND
- 9 SANITARY SEWER SERVICE W/ CLEANOUT BOX & COVER
- 10 4 IN. TOPSOIL W/ SOLID BLOCK SOD OR BERMUDA SEED W/ GREEN SOIL RETENTION BLANKET CLASS 1 TYPE A, B, C, OR D
- 11 SLOPE TOWARDS STREET: 1/4 IN. PER FT. TO 1/2 IN. PER FT.
- 12 CROSS-SLOPE OF SIDEWALK SHALL BE 1.5% DESIGNED AND FORMED. ANY CROSS-SLOPE CONSTRUCTED LESS THAN 1% OR EXCEEDING 2% SHALL NOT BE ACCEPTED
- 13 WHEN NOT IN CONFLICT W/ STORMWATER DRAIN: 2.5 FT. TYPICAL
- 14 WHEN IN CONFLICT W/ STORMWATER DRAIN: 6 FT. TYPICAL OR 18 IN. FROM O.D. OF STORMWATER DRAIN
- 15 GREATER THAN 5 FT. WIDTH MAY BE REQUIRED BY CODE OF ORDINANCES
- 16 FIRE HYDRANT WATER VALVE CONNECTED TO WATER MAIN AS PER DETAIL W-2
- 17 TOP OF RIM = TOC - 0.24 FT. = TOC - 2 7/8 IN.

MINOR COLLECTOR (COMMERCIAL) STREET AND R.O.W. CROSS SECTION WITH UTILITY ASSIGNMENTS

(NO SCALE)