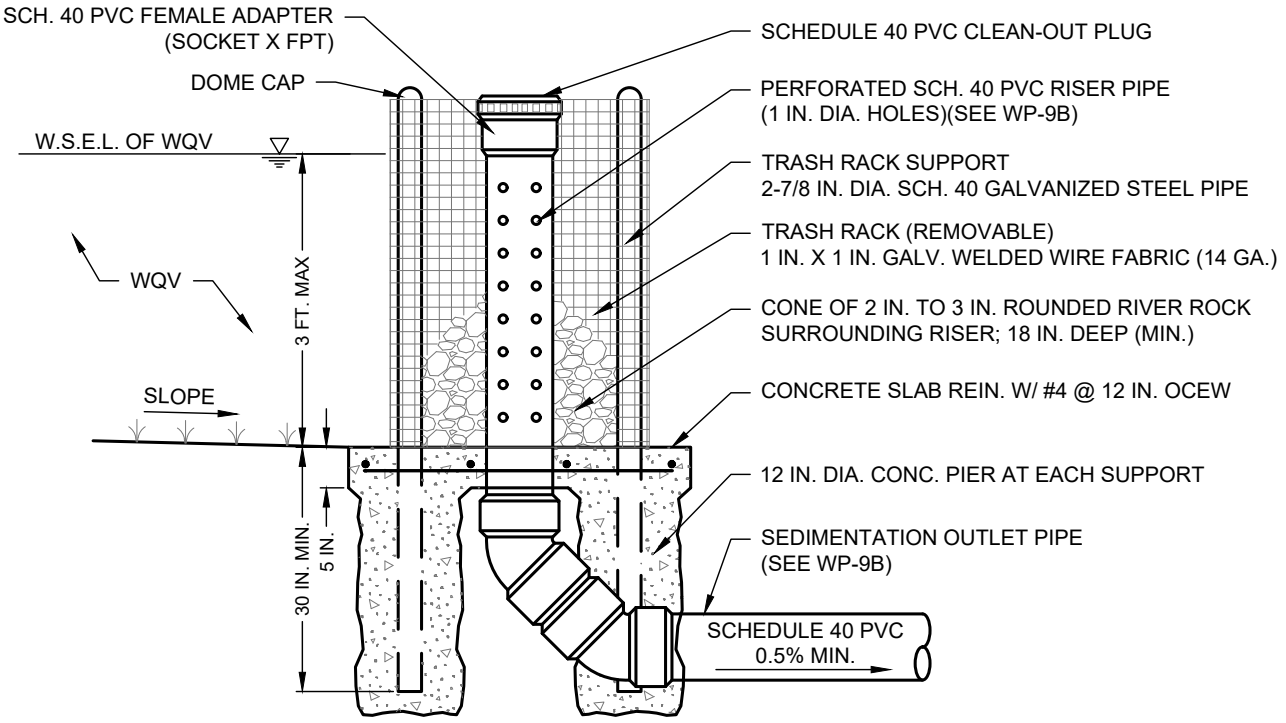

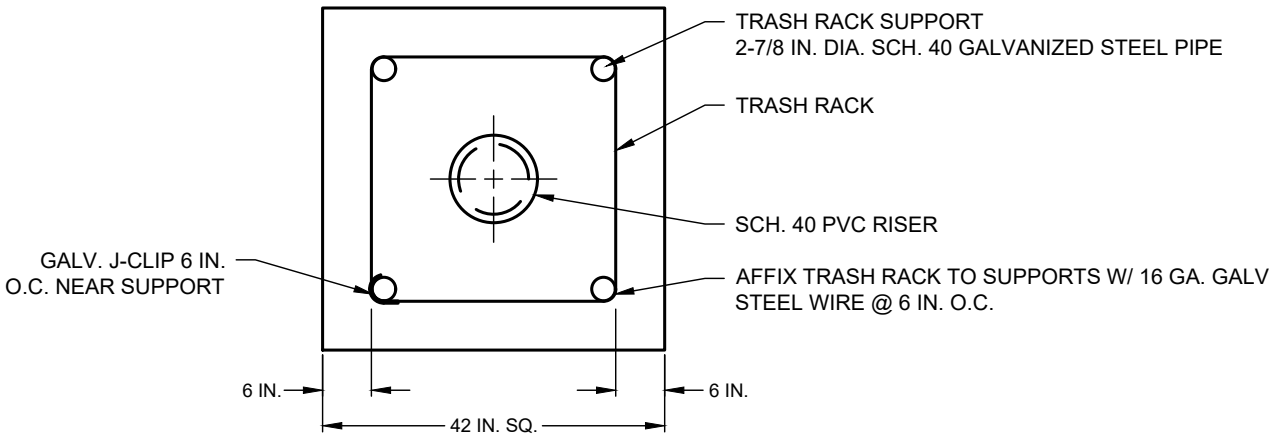

NOTES: THE PERFORATED RISER PIPE AND DISCHARGE OUTLET PIPE SHALL BE PVC SCHEDULE 40. THE MINIMUM DIAMETER OF THE RISER PIPE SHALL BE 8 IN. AND SHALL BE PERFORATED WITH 1 IN. DIAMETER HOLES AS DESCRIBED IN THE TABLE SHOWN ON WP-9B. THE DISCHARGE CAPACITY OF THE PERFORATIONS SHALL EQUAL, OR EXCEED TWO (2) TIMES THE DISCHARGE RATE OF THE ORIFICE OUTLET.

SEDIMENTATION OUTLET STRUCTURE

(NO SCALE)

SEE WP-9B FOR ADDITIONAL DETAILS

CITY OF WACO

ENGINEERING DIVISION

DISCLAIMER: THE USE OF THIS STANDARD IS GOVERNED BY THE "TEXAS ENGINEERING PRACTICE ACT". NO WARRANTY OF ANY KIND IS MADE BY THE CITY OF WACO FOR ANY PURPOSE WHATSOEVER. THE CITY OF WACO ASSUMES NO RESPONSIBILITY FOR THE CONVERSION OF THIS STANDARD TO OTHER FORMATS OR FOR INCORRECT RESULTS OR DAMAGES RESULTING FROM ITS USE.

REVISIONS

NO.	COMMENTS	BY	DATE
##	DESCRIPTION	FL	MM/DD/YYYY

DATE
04/28/2025

WP-9A