
LIP OF GUTTER SHALL BE SAME ELEVATION AS TOP OF SURFACE COURSE. IF BOTTOM OF CURB DOES NOT EXTEND TO TOP OF SUBGRADE FILL MUST BE ONE OF THE FOLLOWING FROM UNDER LIP OF CURB TO 2 FT. BEHIND BACK OF CURB:

- 4 IN. RECYCLED CRUSHED CONCRETE ST-4 FOOTNOTE 1
- 4 IN. MINIMUM COMPACTED ROAD GRAVEL
- 4 IN. MINIMUM COMPACTED STABILIZED SUBGRADE MATERIAL

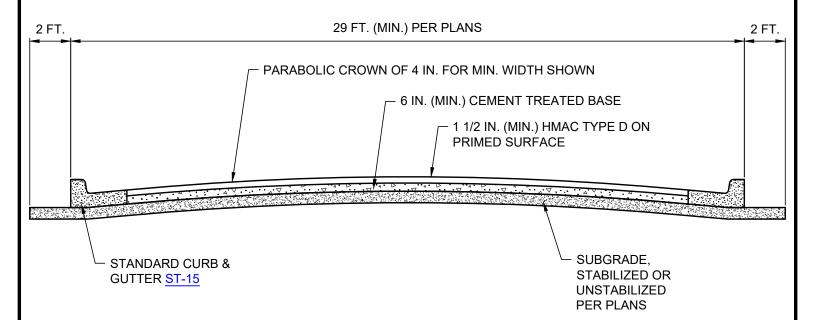

## NOTES:

- 1. THICKNESS OF SURFACE COURSE AND CEMENT TREATED BASE ARE AS PER PLANS AND SHALL MEET OR EXCEED MINIMUMS SHOWN.
- 2. IF PI OF SUBGRADE IS MORE THAN 15,THE SUBGRADE MUST BE STABILIZED. STABILIZATION AGENT AND AMOUNT SHALL BE DETERMINED BY GEOTECHNICAL TESTING AND SHALL BE SPECIFIED ON PLANS.

## **LOCAL STREET SECTION**

(NO SCALE)

PER SUBDIVISION ORDINANCE SEC. 5.2. - PERMANENT IMPROVEMENTS. AND STANDARD SPECIFICATIONS FOR CONSTRUCTION SECTION 2.2 SUBGRADE COURSES 2.2.A SUBGRADE PREPARATION PART 1: GENERAL A. DESCRIPTION



		REVISIONS	DATE		
ENGINEERING DIVISION	NO.	COMMENTS	BY	DATE	
DICCLAIMED. THE HOE OF THIS STANDARD IS CONFEDED BY THE STEVAS					01/01/2024
DISCLAIMER: THE USE OF THIS STANDARD IS GOVERNED BY THE "TEXAS ENGINEERING PRACTICE ACT". NO WARRANTY OF ANY KIND IS MADE BY					
THE CITY OF WACO FOR ANY PURPOSE WHATSOEVER. THE CITY OF WACO					
ASSUMES NO RESPONSIBILITY FOR THE CONVERSION OF THIS STANDARD					CT 2
TO OTHER FORMATS OR FOR INCORRECT RESULTS OR DAMAGES					31 <b>-</b> 2
RESULTING FROM ITS USE.	##	DESCRIPTION	FL	MM/DD/YYYY	