


SANITARY SEWER SERVICE - RESIDENTIAL

(NO SCALE)

- EXISTING MAIN REQUIRES A GASKETED, RIGID, WYE AND A COUPLING THAT RESISTS SHEARING.
- 4 IN. RESIDENTIAL SERVICE REQUIRES 2. SINGLE 2 WAY CLEANOUT.
- CLEANOUTS IN ALLEYS TO BE 18 IN. ABOVE SURFACE, NEXT TO PROPERTY LINE, WITH NO BOX.
- **CLEANOUT SHALL BE 340-1 DALLAS** SHORTY VALVE BOX W/ SEWER LID. MATERIAL IS CAST IRON, ASTM A48, CLASS 30B OR PRE-APPROVED EQUAL.
- REFER TO STANDARD DETAILS W-35 OR W-36 FOR REQUIREMENTS FOR CLEANOUTS LOCATED IN TRAFFIC AREAS.
- IF SEWER DEPTH IS GREATER THAN 10 FT.. THEN S-3 DEEP SANITARY SEWER SERVICE CONNECTION SHALL BE USED.

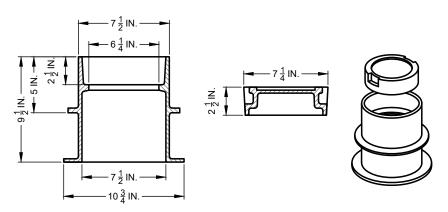

CLEANOUT BOX & COVER

(NO SCALE)



ENGINEERING DIVISION

DISCLAIMER: THE USE OF THIS STANDARD IS GOVERNED BY THE "TEXAS ENGINEERING PRACTICE ACT". NO WARRANTY OF ANY KIND IS MADE BY THE CITY OF WACO FOR ANY PURPOSE WHATSOEVER. THE CITY OF WACO ASSUMES NO RESPONSIBILITY FOR THE CONVERSION OF THIS STANDARD TO OTHER FORMATS OR FOR INCORRECT RESULTS OR DAMAGES RESULTING FROM ITS USE.

	NO.	COMMENTS	BY	DATE	DATE
S					01/01/2024
0					C 2
S	##	DESCRIPTION	FL	MM/DD/YYYY	3-2